



# CAN-5900 Series

## I/O Expansion Modules

### DESCRIPTION

KMC Conquest™ CAN-5900 series input/output expansion modules are designed for use with BAC-5900 series controllers. Multiple modules can be connected to a controller via the EIO communications port (a CAN bus). Each CAN-5901 supports up to eight inputs and eight outputs. Each CAN-5902 supports up to sixteen inputs.

A BAC-5900 series controller with four connected CAN-5900 series modules can access up to 74 physical (Room Sensor port and terminal block) inputs and up to 40 outputs:

- With four CAN-5901 modules, the controller can access 42 inputs and 40 outputs.
- With four CAN-5902 modules, the controller can access 74 inputs and 8 outputs.
- CAN-5901 and CAN-5902 modules can also be “mixed and matched” for a desired number of inputs and outputs.



One BAC-5901 And...		Provides...	
CAN-5901s	CAN-5902s	Inputs*	Outputs
0	0	10	8
1	0	18	16
2	0	26	24
3	0	34	32
4	0	42	40
0	1	26	8
0	2	42	8
0	3	58	8
0	4	74	8
1	3	66	16
2	2	58	24
3	1	50	32

\*Up to 74 physical inputs are possible, but up to 106 input objects can be created (with 32 unused) for addressing.

### APPLICATIONS

I/O expansion modules for BAC-5900 series controllers can be used with equipment such as:

- Air handling units
- Boilers
- Chillers
- Pumps
- Cooling towers
- Roof top units
- Heat pump units
- Fan coil units
- Unit ventilators
- Other HVAC and building automation system equipment

(See also [Sample Installation on page 5.](#))

### MODELS


APPLICATIONS	INPUTS*	OUTPUTS*	MODEL
Input/Output Expansion	8 universal (software configurable as analog, binary, or accumulator)	8 universal • Software configurable as analog or binary • Override boards give additional options**	<b>CAN-5901</b>
Input Expansion	16 universal (software configurable as analog, binary, or accumulator)	None	<b>CAN-5902***</b>

\*Up to four CAN-5900 series expansion modules can be used with BAC-5900 series controllers to provide up to 74 inputs or 40 outputs. CAN-5900 modules have only terminal block inputs and do not have a Room Sensor port.


\*\*HPO-6700 series output override board series provide (triac, NC/NO relays, 4–20 mA, adjustable 0–10 VDC) options for devices that cannot be powered from a standard universal output. The boards can also be used with the CAN-5901.

\*\*\*A CAN-5902 requires a BAC-5900 series controller with firmware version R1.2.0.9 or later.

# SPECIFICATIONS

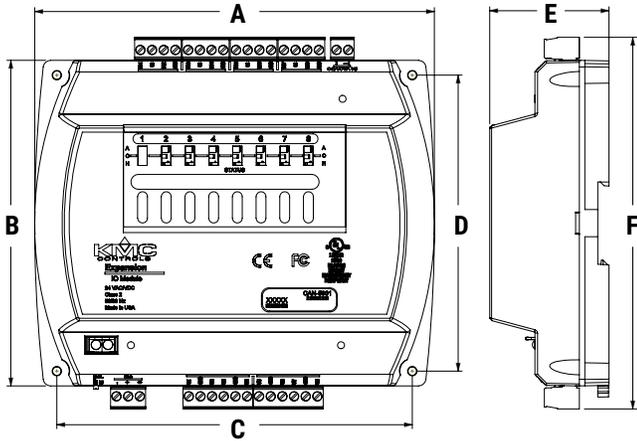

DIMENSIONS		
<b>A</b>	6.744 inches	171 mm
<b>B</b>	5.500 inches	140 mm
<b>C</b>	6.000 inches	152 mm
<b>D</b>	5.000 inches	127 mm
<b>E</b>	2.012 inches (CAN-5901)	51 mm (CAN-5901)
	1.500 inches (CAN-5902)	38 mm (CAN-5902)
<b>F</b>	6.279 inches	159 mm

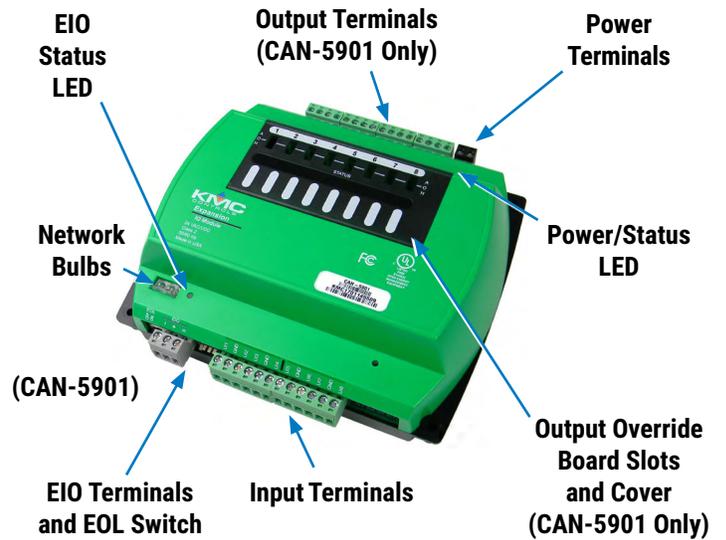

## Inputs and Outputs

### Inputs, Universal

Universal inputs	Configurable as analog, binary, or accumulator objects (8 on CAN-5901, 16 on CAN-5902)
Termination	1K and 10K ohm sensors, 0–12 VDC, or 0–20 mA (without need for an external resistor)
Resolution	16-bit analog-to-digital conversion
Protection	Overvoltage protection (24 VAC, continuous)
Wire size	12–24 AWG, copper, in removable screw terminal blocks

TERMINAL COLOR CODE	
<b>Black</b>	24 VAC/VDC Power
<b>Gray</b>	CAN Communications
<b>Green</b>	Inputs/Outputs

### Outputs, Universal (CAN-5901 Only)

Universal outputs	Configurable as an analog (0 to 12 VDC) or binary object (0 or 12 VDC, on/off); alternately, an output override board is installed for devices that cannot be powered from a standard universal output (8 on CAN-5901)
Power/protection	Each short-circuit protected universal output capable of driving up to 100 mA (at 0–12 VDC) or 300 mA total for all outputs
Resolution	12-bit digital-to-analog conversion
Wire size	12–24 AWG, copper, in removable screw terminal blocks

## Communication Ports

EIO Expansion	One CAN serial bus connection (terminal block) for daisy-chaining I/O expansion modules up to 200 feet (61 meters) from the controller via standard shielded twisted-pair wire
---------------	--

## Configuration Tools

Via BAC-5901	KMC Connect software, TotalControl software, or KMC Converge module for Niagara WorkBench
--------------	---

## Hardware Features

### Processor, Memory, and Clock

Processor	32-bit ARM® Cortex-M4
Memory	Configuration parameters are stored in nonvolatile memory; auto restart on power failure

### Indicators and Isolation

LED indicators	Power/status and EIO (CAN) communication
Communication bulbs	One EIO (CAN) communications bulb assembly indicates reversed polarity and isolates circuit
Switch	EOL (end of line) for EIO (CAN) bus

## Installation

### Power

Supply voltage	24 VAC (50/60 Hz) or 24 VDC; -15%, +20%; Class 2 only; non-supervised (all circuits, including supply voltage, are power limited circuits)
Required power	14 VA, plus external loads
Wire size	12–24 AWG, copper, in a removable screw terminal block

## Enclosure and Mounting

Weight	14 ounces (0.4 kg)
Case material	Green and black flame retardant plastic
Mounting	Direct mounting to panels or DIN rails

## Environmental Limits

Operating	32 to 120° F (0 to 49° C)
Shipping	-40 to 160° F (-40 to 71° C)
Humidity	0 to 95% relative humidity (non-condensing)

## Warranty, Protocol, and Approvals

### Warranty

KMC Limited Warranty	5 years (from mfg. date code)
----------------------	-------------------------------

### Protocol

CAN	CAN (Controller Area Network) bus on EIO terminals
-----	--

### Regulatory Approvals

UL (both) (CAN-5901 only)	UL 916 Energy Management Equipment listed  UL 864 Smoke Control Equipment listed (UUKL), 10th edition—for smoke control applications, see <a href="#">Smoke Control Manual for KMC Conquest Systems</a> , P/N 000-035-18)
CE	CE compliant
RoHS	RoHS compliant
FCC (for CAN-5901)	FCC Class A, Part 15, Subpart B and complies with Canadian ICES-003 Class A*
FCC (for CAN-5902)	FCC Class B, Part 15, Subpart B and complies with Canadian ICES-003 Class B*

\*This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

## ACCESSORIES

**NOTE:** For accessory details, see the respective product data sheets and installation guides.

### Actuators and Sensors

<b>MEP-4xxx</b>	Actuators, 25 to 90 in-lb., fail-safe and non-fail-safe
<b>MEP-7xxx</b>	Actuators, 180 and 320 in-lb., fail-safe and non-fail-safe
<b>STE-60xx</b>	Room temperature sensors
<b>STE-14xx</b>	DAT, OAT, and other temp. sensors

### Miscellaneous Hardware

<b>HCO-1103</b>	Steel control enclosure, 10-1/8 x 2-5/8 x 7-19/32 inches (257 x 67 x 193 mm)
<b>HCO-1035</b>	Steel control enclosure, 20 x 24 x 6 inches (508 x 610 x 152 mm)*
<b>HCO-1036</b>	Steel control enclosure, 24 x 36 x 6 inches (610 x 914 x 152 mm)*
<b>HPO-0055</b>	Replacement network bulb assembly (pack of 5)
<b>HPO-0063</b>	Replacement output (override board) jumper, 2-pin (pack of 5)
<b>HPO-9901</b>	Controller replacement parts kit with terminal blocks and DIN clips

**\*NOTE:** For smoke control applications, the CAN-5901 must be mounted in a UL Listed FSCS enclosure or listed enclosure with minimum dimensions. The HCO-1035 and HCO-1036 are approved for such applications. The CAN-5902 is not approved for smoke control applications.

### Output Override Boards (for CAN-5901)


<b>HPO-6701**</b>	Triac output w/ zero-cross switching (AC only)
<b>HPO-6702</b>	0–10 VDC analog with adjustable override potentiometer
<b>HPO-6703</b>	Relay, NO contacts (AC/DC)
<b>HPO-6704**</b>	4–20 mA DC current loop with adjustable override potentiometer
<b>HPO-6705</b>	Relay, NC contacts (AC/DC)

**\*\*NOTE:** Only the HPO-6701 and HPO-6704 of the HPO-6700 series output override boards are approved for smoke control applications. The CAN-5902 is not approved for smoke control applications, and it does not have outputs.

### Transformers, 120 to 24 VAC

<b>XEE-6111-050</b>	50 VA, single-hub
<b>XEE-6112-050</b>	50 VA, dual-hub
<b>XEE-6112-100</b>	96 VA, dual-hub (approved for smoke control applications)

## SAMPLE INSTALLATION

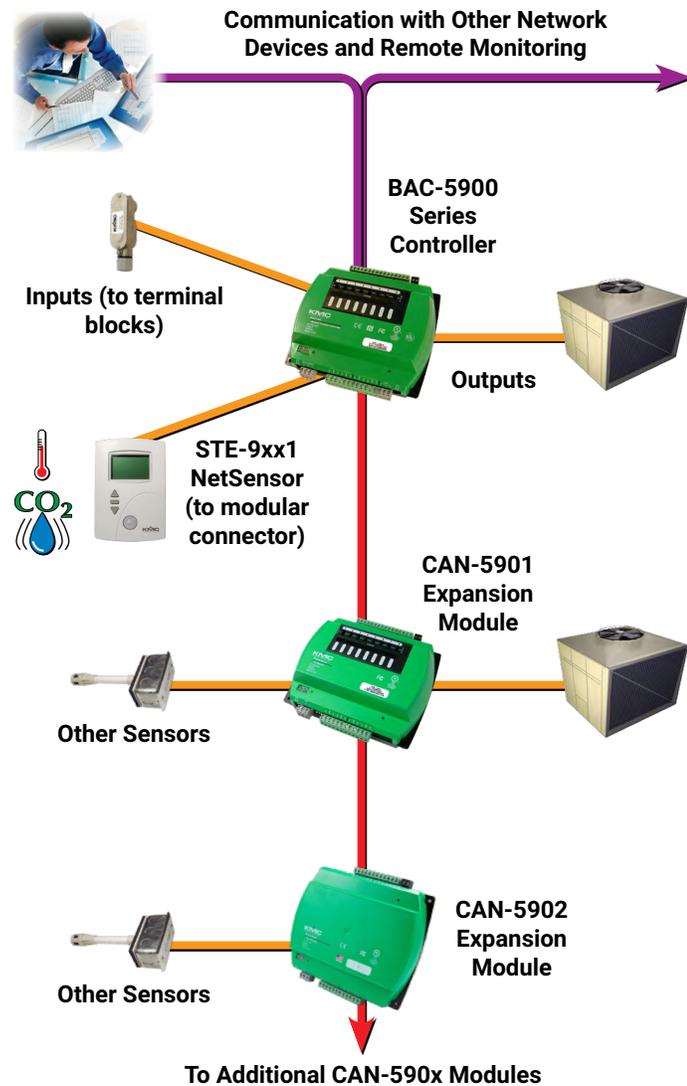

## SUPPORT

Additional resources for installation, configuration, application, operation, programming, upgrading, and much more are available on the web at [www.kmccontrols.com](http://www.kmccontrols.com). Log-in to see all available files.



For more information about installation and operation, see:

- [CAN-5900 Series Expansion I/O Module Installation Guide](#)
- [KMC Conquest Controller Application Guide](#)
- [Smoke Control Manual for KMC Conquest Systems \(CAN-5901 only\)](#)